

NOTES:
1. THIS DETAIL APPLIES TO THE SYMBOL ▼ OR ▼ W SHOWN ON THE FLOOR PLANS.

NOTES:
1. THIS DETAIL APPLIES TO THE SYMBOL ▼ SHOWN ON THE FLOOR PLANS.

NOTES:
1. SECONDARY PATHWAY CABLE SUPPORTS ARE TO BE USED AS NECESSARY FOR CABLES TO COMPLY WITH EIA/ITA REQUIREMENTS FOR CABLE SUPPORT. OTHER ALTERNATIVES MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL PRIOR TO INSTALLATION.
2. ALL SUPPORTS SHALL BE SPACED ON 5'-0" MAX CENTERS.
3. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR MAX LOADING, APPLICATION REQUIREMENTS, AND SECURING TO STRUCTURE.
4. ALL CABLE SUPPORTS SHALL BE SPECIFICALLY MANUFACTURED TO SUPPORT HIGH SPEED COMMUNICATIONS CABLES.
5. ROUTE CABLES VIA SECONDARY PATHWAY FROM PRIMARY PATHWAY (WIRE BASKET IN CORRIDOR) DIRECTLY TO ROOM BEING FED. DO NOT ROUTE CABLES THROUGH ANY ROOM OTHER THAN THE ROOM BEING FED. IF CABLES MUST BE FEED THROUGH ROOMS OR AREAS WITHOUT WIREBASKET, ROUTE NOW MORE THAN FOUR CAT 6 CABLES IN A 1" C.

TELECOMMUNICATIONS OUTLET #1 ELEVATION

TELECOMMUNICATIONS OUTLET #2 ELEVATION

COMMUNICATIONS CABLING SUPPORT DETAIL

100% Construction Documents	08/05/10	ASSOCIATES DIRECTOR PATIENT CARE	INFECTION CONTROL	SUPERVISOR M&O	PROJECT MANAGER
		TEAMSTER	CONTRACTING OFFICER	GEN UTILITIES	SAFETY OFFICE
		POLICE	PATIENT SAFETY	GEN PROPERTIES	SUPERVISOR PROJECT SECTION
Revisions	Date				

ARCHITECT / ENGINEERS :

Francis Cauffman

2120 Arch Street
Philadelphia, PA 19103

Tel (215) 568-8250
Fax (215) 568-2639


H.F. Lenz Company

1407 Scalp Avenue
Johnstown, PA 15904-3214
T: 814.269.9300
F: 814.269.9301

EUSTACE ENGINEERING

447 West Moreland Road
3rd Floor
Willow Grove, PA, 19090

Tel: (215) 348-8767
Fax: (215) 348-8768
www.eustaceeng.com

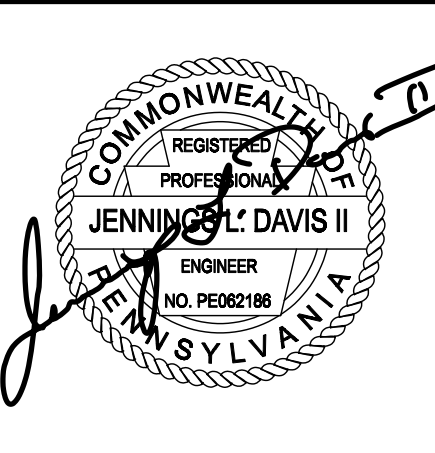

Drawing Title ELECTRICAL DETAILS		Project Title CONSTRUCT HOSPICE COATESVILLE		Date 08-05-2010
Approved: Chief Engineering Service		Building Number		Project No. 542-CSI-201
Approved: Medical Center Director		Location COATESVILLE, PENNSYLVANIA		Drawing No. EK5.02
Drawn RJD		Checked JLD		Dwg. Of